


P-164/264 REPLACEMENT PARTS

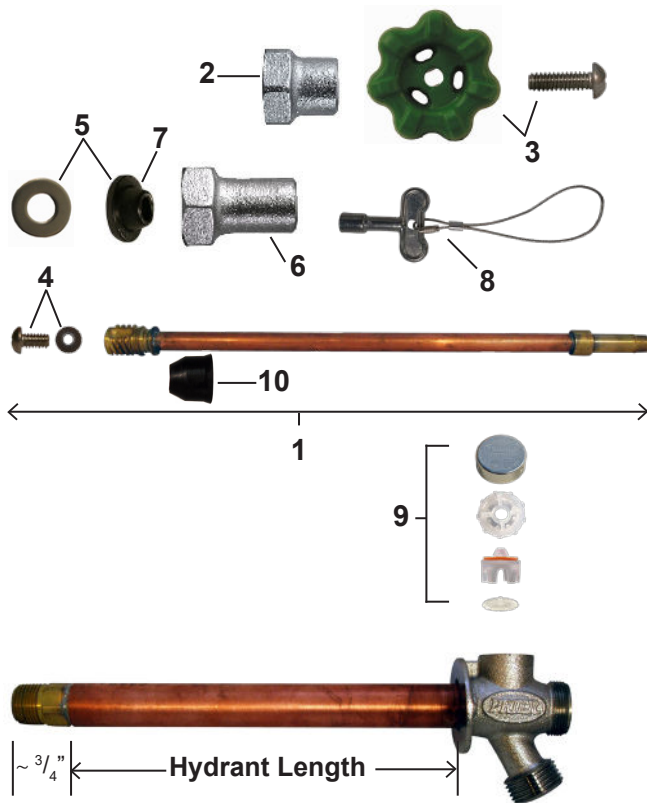

ID	Part No.	Description
1	See Replacement Stem Section	Stem Assembly, Contains: 1, 4, 10
2	300-1008	Valve Stem Cap
3	P-164KT-805	Handle and Screw Kit
4	C-134KT-802	Seat Washer Replacement Kit (00 Beveled)
5	C-134KT-803	Stem Packing Replacement Kit
6	310-1015	Valve Stem Cap for Loose Key
7	336-0043	Stem Packing Only
8	C-108KT-808	Oval Style Key on Lanyard
9	C-144KT-806	Universal Vacuum Breaker Replacement Kit
10	336-0002	Backflow Check Valve for P-164
	C-134KT-804	Handle to Loose Key Conversion Kit Contains: 5,6,8
	P-264KT-804	Loose Key to Handle Conversion Kit Contains: 2, 3, 5
	P-164KT-807	P-164 Overhaul Kit Contains: 3, 4, 5, 9, 10

*The C-144KT-806 Universal Vacuum Breaker Kit fits all current and past PRIER and Mansfield style residential hydrants.

REPLACEMENT STEMS



H Style Manufactured April 2013 - Present

Part No.	Style	Stem Length	Description
P-231-15CC	H	4 1/2" OAL	Close Coupled Stem for P-164 Hydrant
P-231-1504	H	7" OAL	Stem for P-164 Series 4" Hydrant
P-231-1506	H	9" OAL	Stem for P-164 Series 6" Hydrant
P-231-1508	H	11" OAL	Stem for P-164 Series 8" Hydrant
P-231-1510	H	13" OAL	Stem for P-164 Series 10" Hydrant
P-231-1512	H	15" OAL	Stem for P-164 Series 12" Hydrant
P-231-1514	H	17" OAL	Stem for P-164 Series 14" Hydrant
P-231-1516	H	19" OAL	Stem for P-164 Series 16" Hydrant
P-231-1518	H	21" OAL	Stem for P-164 Series 18" Hydrant
P-231-1520	H	23" OAL	Stem for P-164 Series 20" Hydrant
P-231-1522	H	25" OAL	Stem for P-164 Series 22" Hydrant
P-231-1524	H	27" OAL	Stem for P-164 Series 24" Hydrant
P-231-15US	H	Up to 17" OAL	*Universal Replacement Stem for P-164 Hydrant

**For stems manufactured before 2013, see P-164 Series retired style spec sheet at PRIER.com. PRIER universal stems are replacement stems for any size from close coupled to 14." The P-231-15US Universal Stem requires cutting the rod to proper length and soldering the brass stem end to the rod as directed in instructions.

4515 E. 139th Street Grandview, MO 64030 | (800) 362-9055 | PRIER.com

*Per ASSE 1019 Code, do not leave on for more than 12 continuous hours.